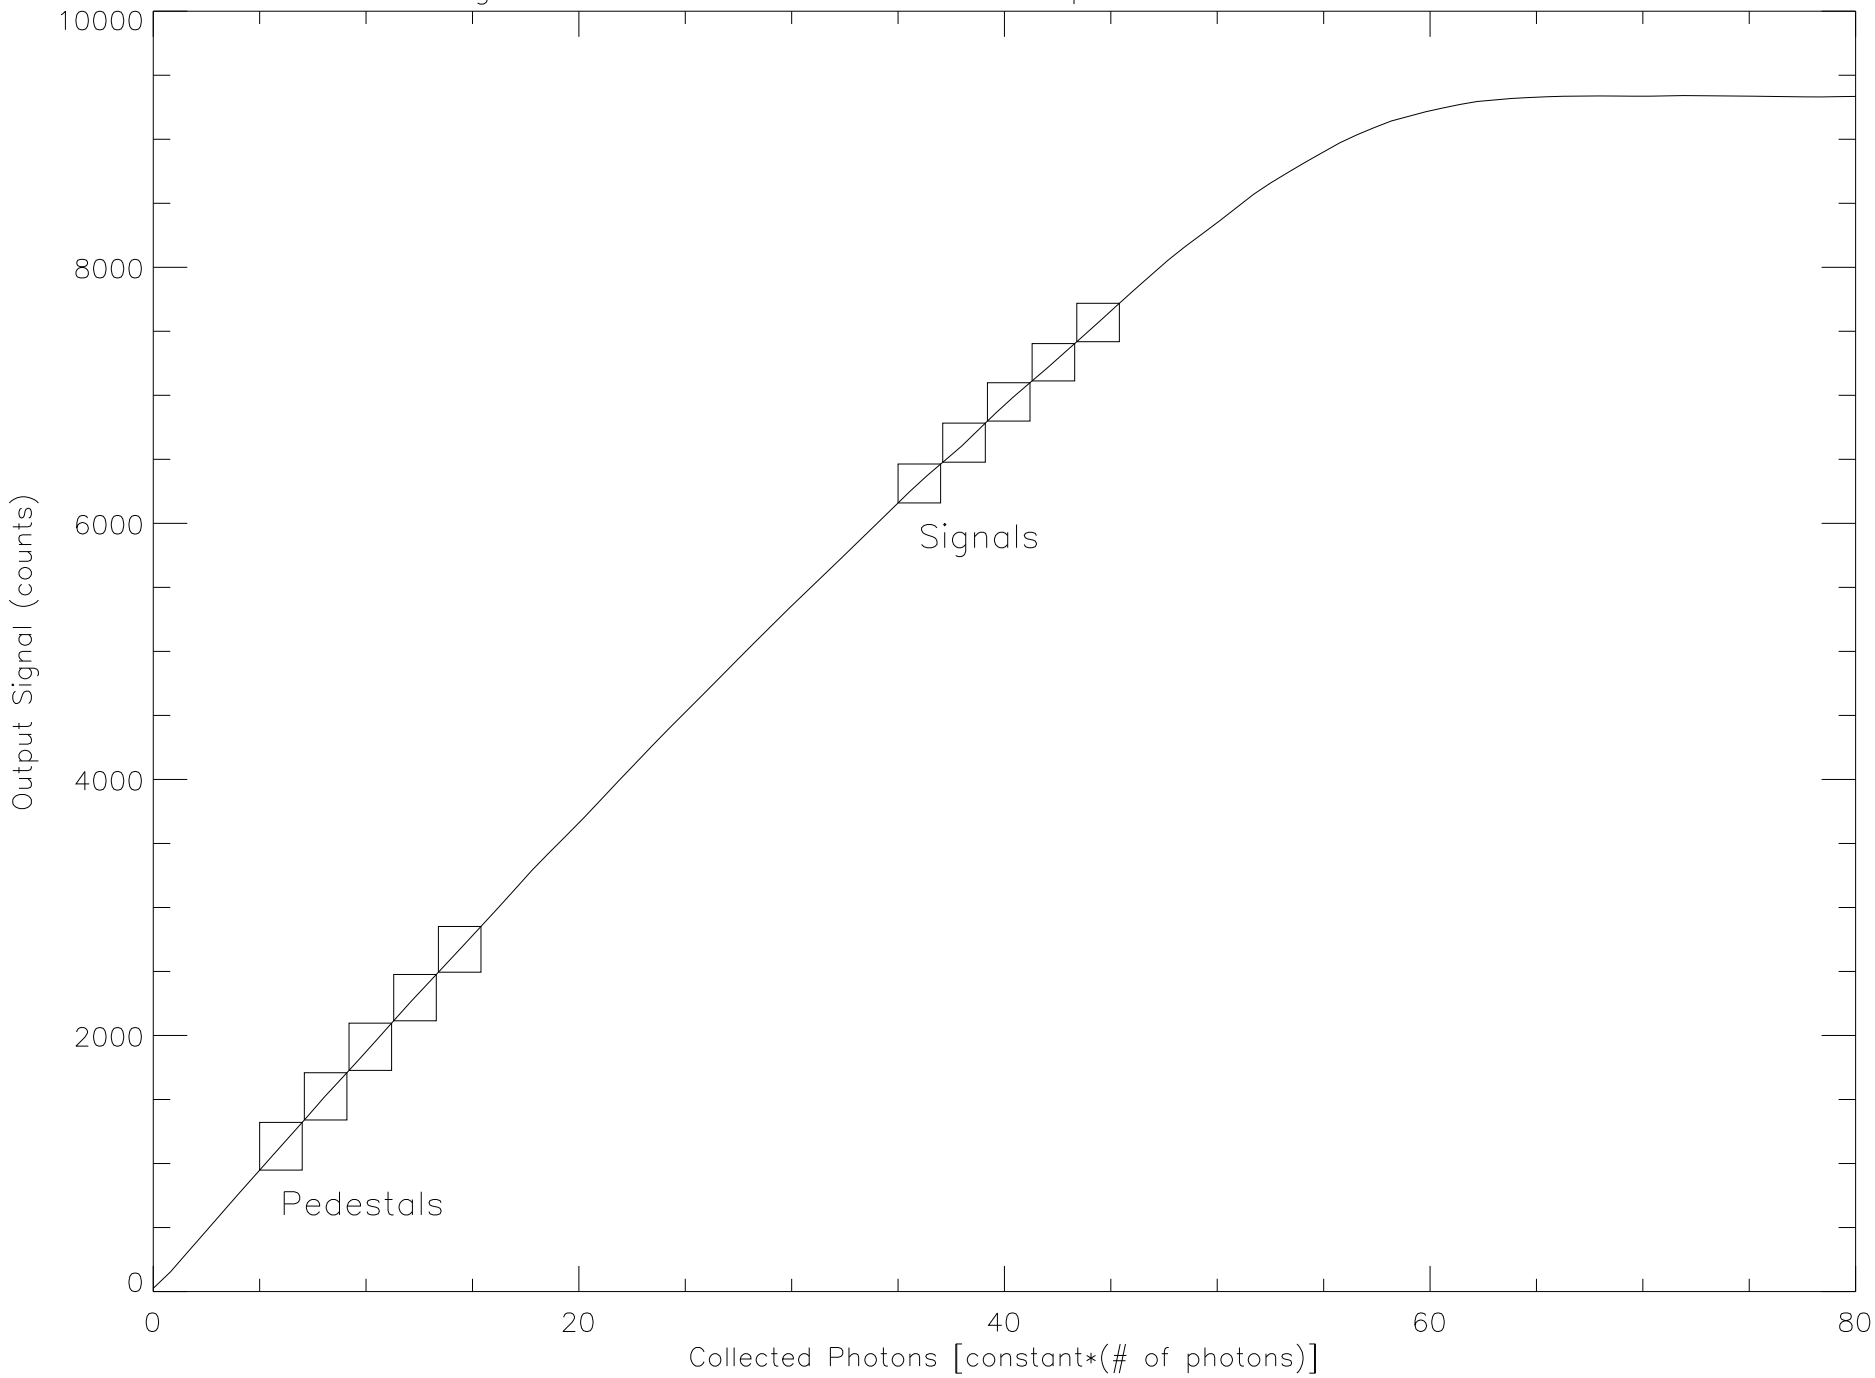Figure 12: Correlated Double-Sampled Non-Destructive Reads